

図5.1.4 Case2 初期濃度1,000ppm (ヒ素換算値) 汚染推移 (10ppm)

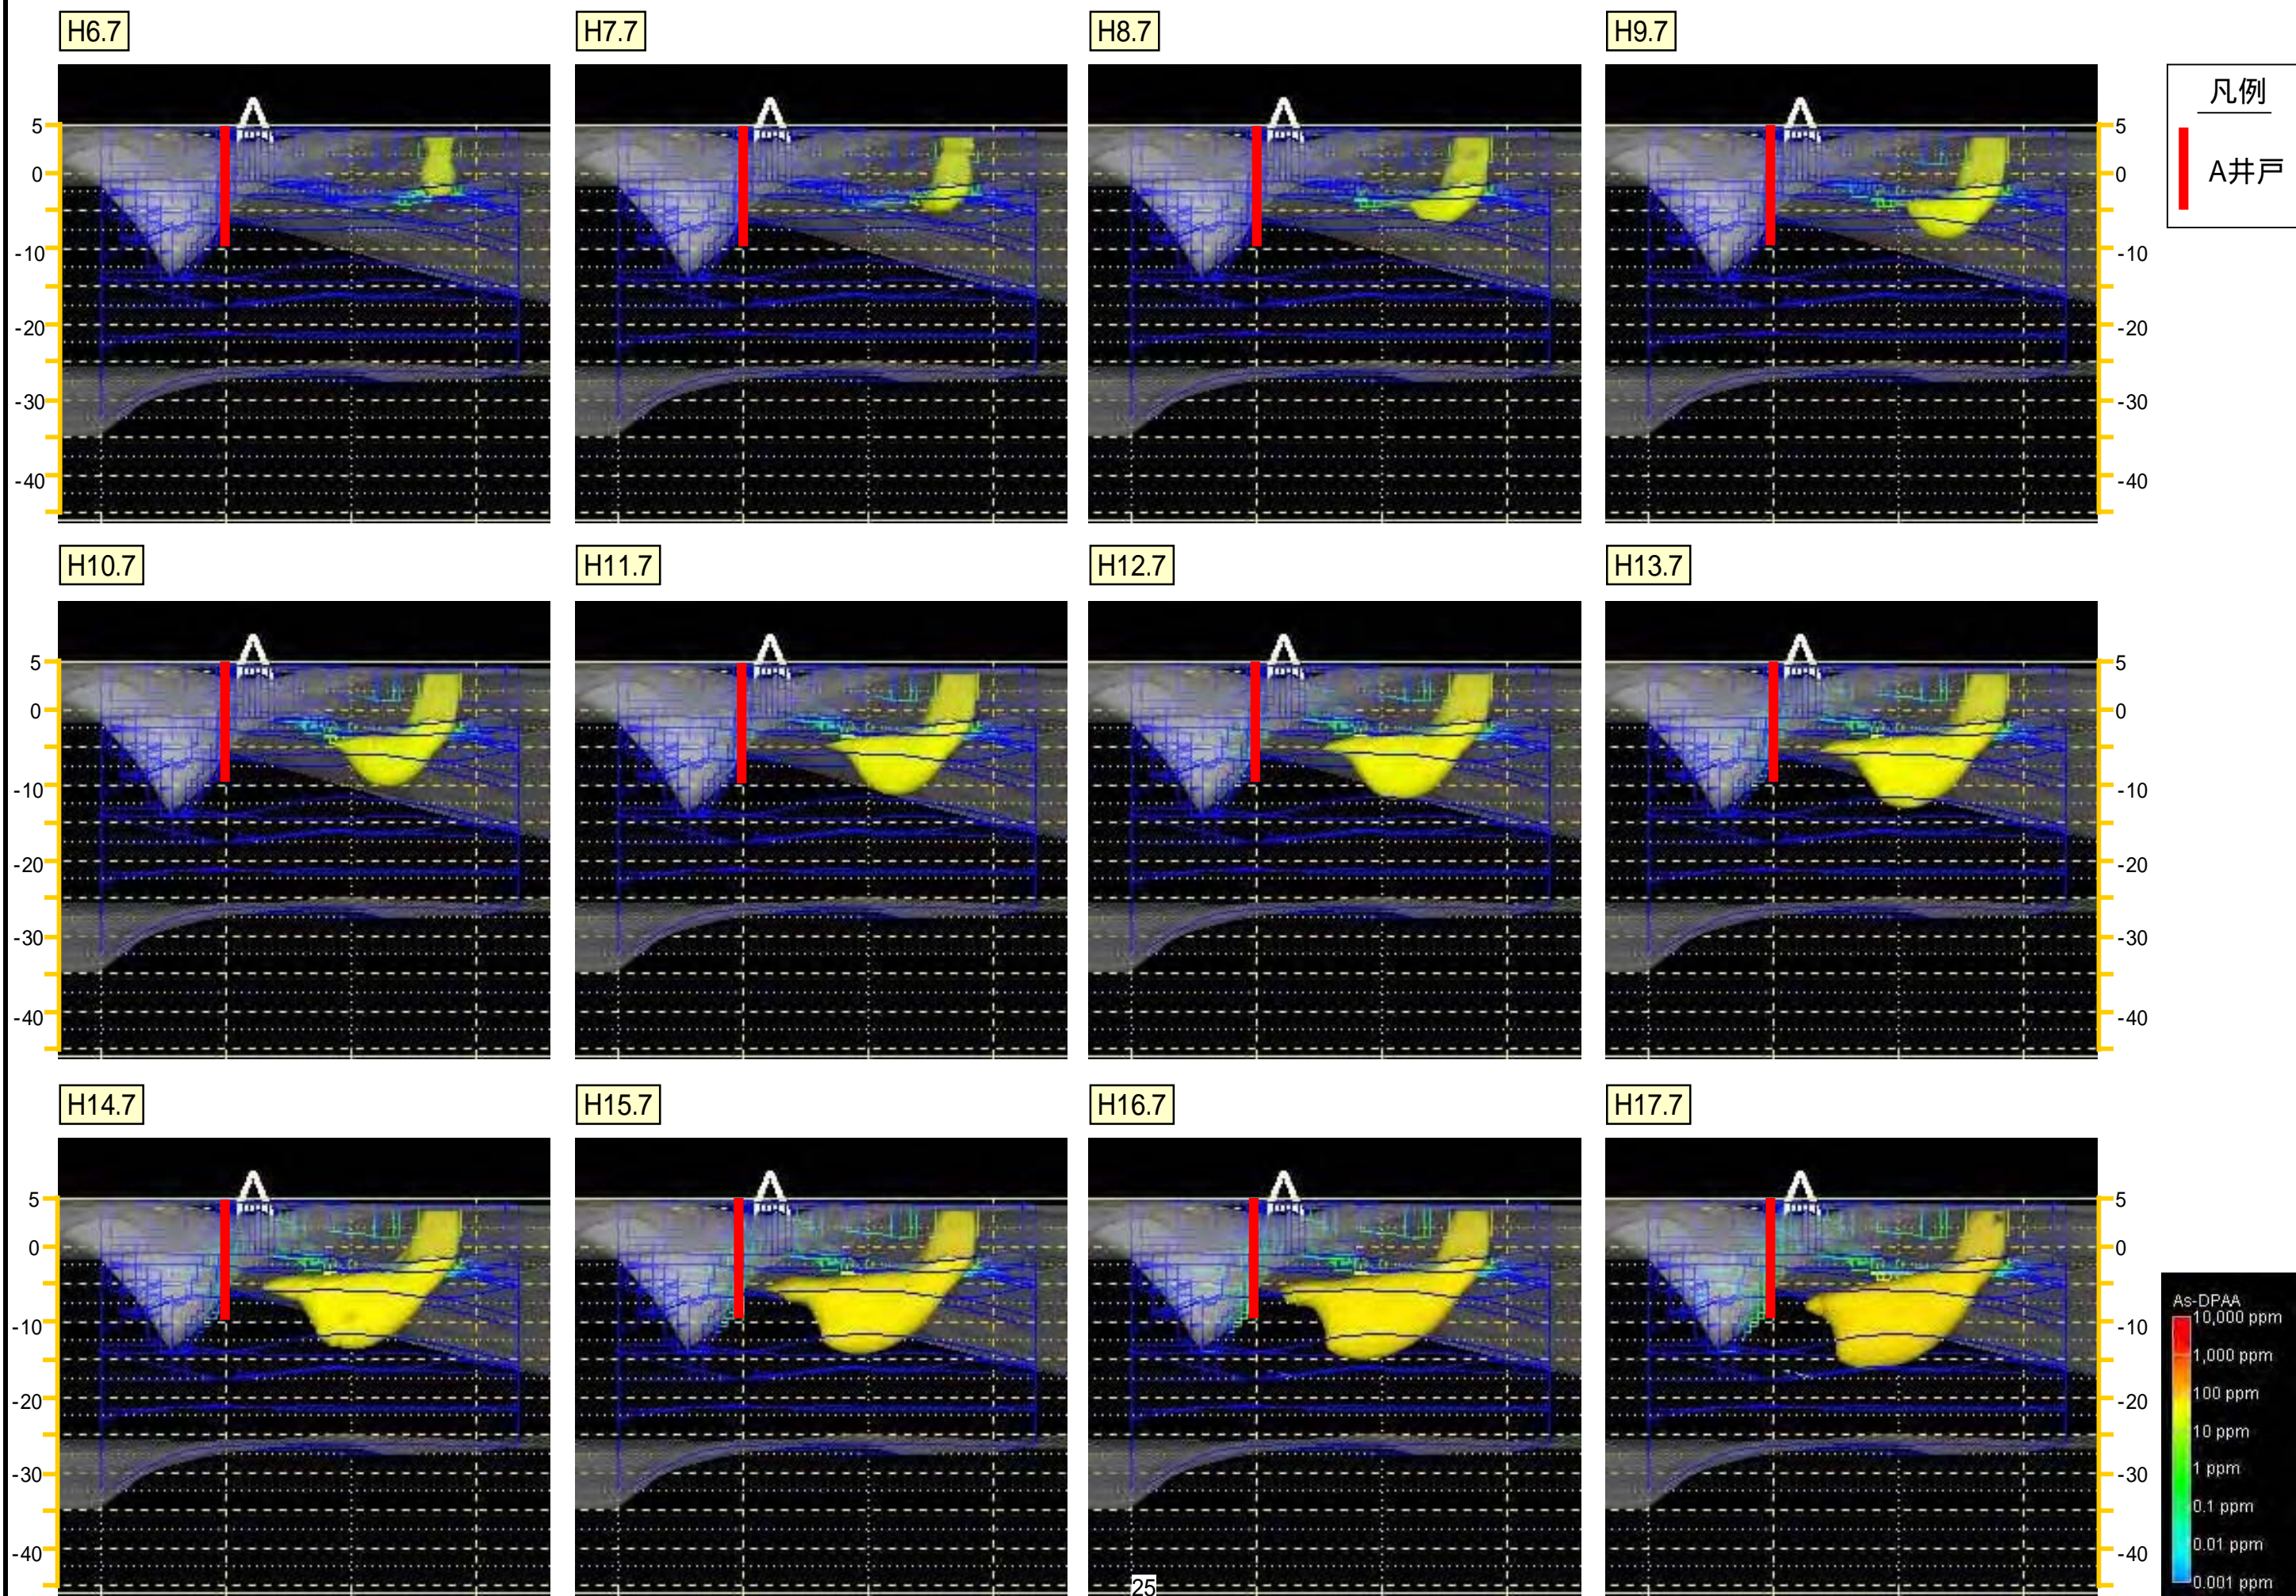




図5.1.4 Case2 初期濃度1,000ppm (ヒ素換算値) 汚染推移 (5ppm)

