


## 法定検査の受検率の推移

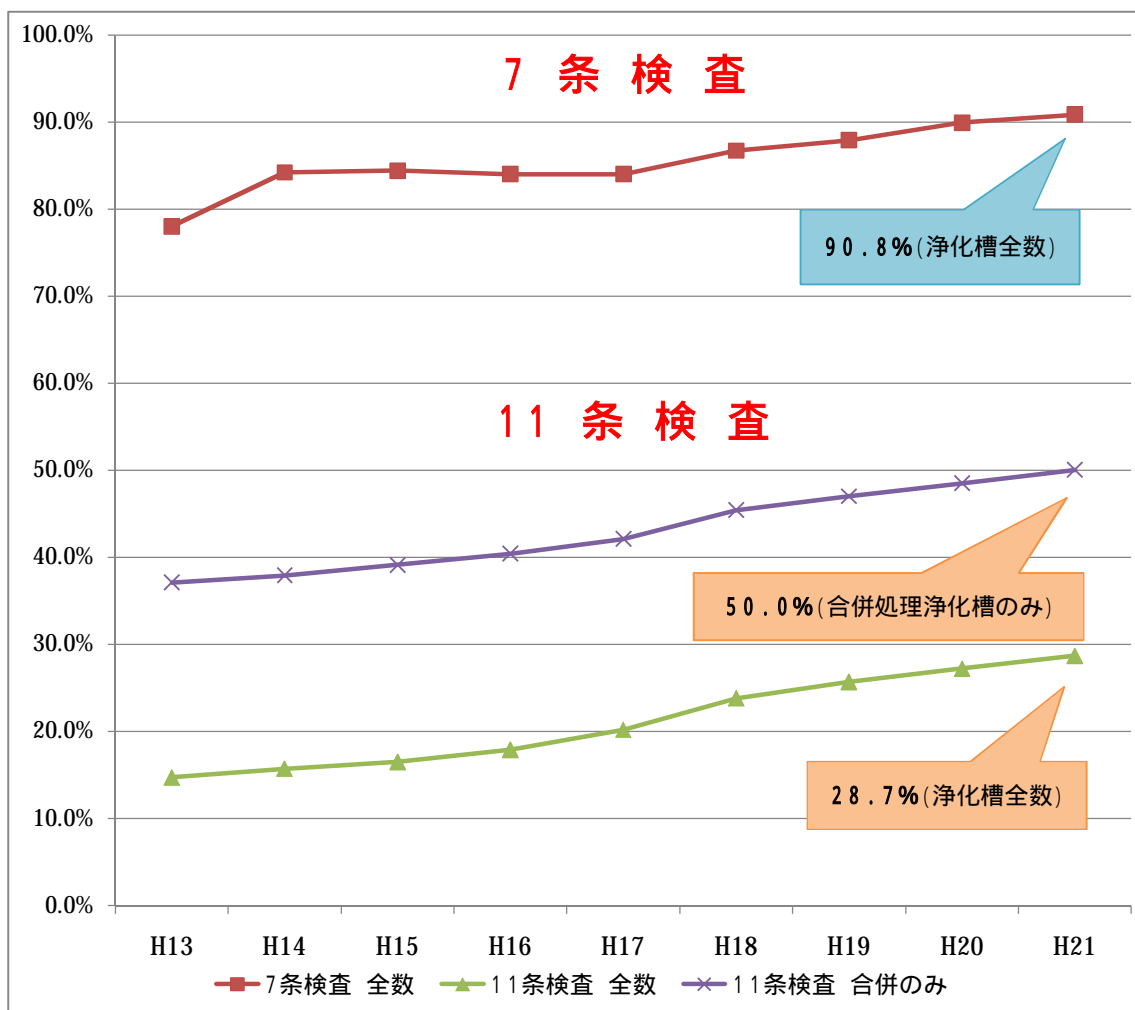

|       |           | H13   | H14   | H15   | H16   | H17   | H18   | H19   | H20   | H21   |
|-------|-----------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 7条検査  | 浄化槽全数     | 78.0% | 84.2% | 84.4% | 84.0% | 84.0% | 86.7% | 87.9% | 89.9% | 90.8% |
|       | 合併処理浄化槽のみ | 37.1% | 37.9% | 39.1% | 40.4% | 42.1% | 45.4% | 47.0% | 48.5% | 50.0% |
| 11条検査 | 浄化槽全数     | 14.7% | 15.7% | 16.5% | 17.9% | 20.2% | 23.8% | 25.7% | 27.2% | 28.7% |
|       | 合併処理浄化槽のみ | 37.1% | 37.9% | 39.1% | 40.4% | 42.1% | 45.4% | 47.0% | 48.5% | 50.0% |